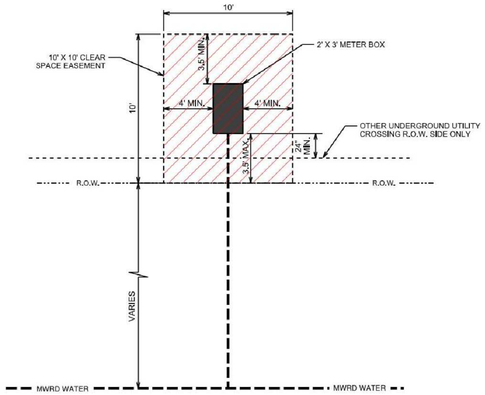

NOTES:

1. CLEAR SPACE TO BE VOID OF DRAINAGE FACILITIES, STRUCTURES, DRIVEWAYS, MAILBOXES, SIDEWALKS, TREES, PUBLIC UTILITIES AND UTILITY SERVICE CONNECTIONS.
2. SEWER SERVICE LINE AND TREES TO BE LOCATED A MINIMUM 10 FT. AWAY FROM WATER SERVICE.
3. OTHER UNDERGROUND UTILITY CROSSINGS SHALL COMPLY WITH SEPARATION REQUIREMENTS OUTLINED IN TECHNICAL SPECIFICATIONS.

CLEAR SPACE

METER CLEAR SPACE REQUIREMENT

N.T.S.

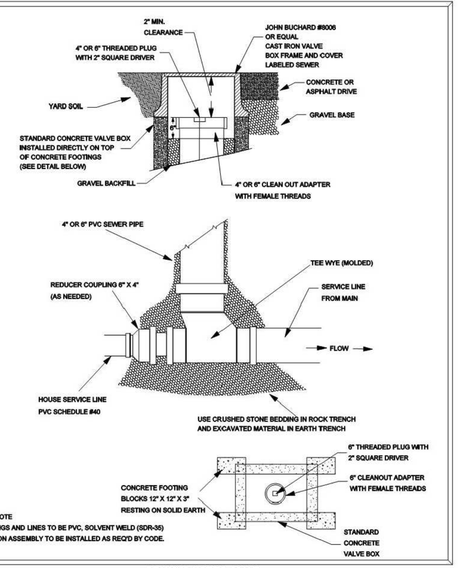

GENERAL NOTE
- ALL FITTINGS AND LINES TO BE PVC, SOLVENT WELD (SDR-35)
- INSPECTION ASSEMBLY TO BE INSTALLED AS REQ'D BY CODE.

DRAWING NOT TO SCALE

APRIL 24, 2006 DRAWN BY: KMC APPROVED BY: GH	EXTERIOR SEWER SERVICE CLEANOUT DETAIL	STANDARD DRAWING NO. P-3

MURFREESBORO WATER & SEWER DEPARTMENT

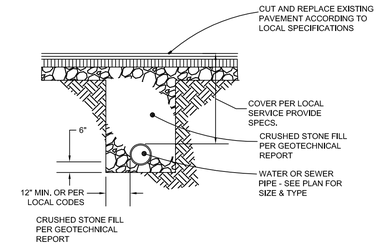

UTILITY TRENCH DETAIL

N.T.S.

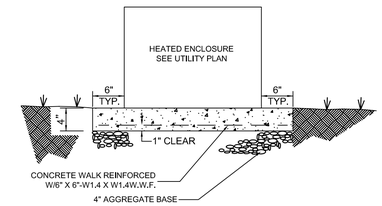

NOTE:

1. SUBGRADE COMPACTED PER SOILS REPORT.
2. CONDUITS AND WATERLINES THRU PAD AS REQUIRED PER SERVICE PROVIDER SPECS.

CONCRETE PAD AT BACKFLOW PREVENTER

N.T.S.

CFT NV DEVELOPMENTS, LLC
TOWN CENTER DRIVE,
SUITE 150
LAS VEGAS, NV 89144
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

	PERMIT/BID SET	06-01-21

DRAWN BY: PTD

CFT PROJECT #:	CT1366
CFT STORE #:	CT1366
ARCH PROJECT #:	20045.003

RAY G. FLAKE
REGISTERED PROFESSIONAL ENGINEER
ARCHITECTURE
NO. 106000
STATE OF TENNESSEE
06/01/2021

Civil Engineering Services
Engineering, Land Planning, and Environmental
7705 Spicer Farm Lane
Fairview, Tennessee
37062
Phone: (615) 533-0401
e-mail: ray@civilengineeringservices.net

CFT RETAIL BUILDING

2901 S. CHURCH ST
MURFREESBORO, TN 37127

UTILITY DETAIL SHEET

C04.1