NOT USED | 21

Scale= 1" = 1'-0" | A-404

WALL BASE | 14

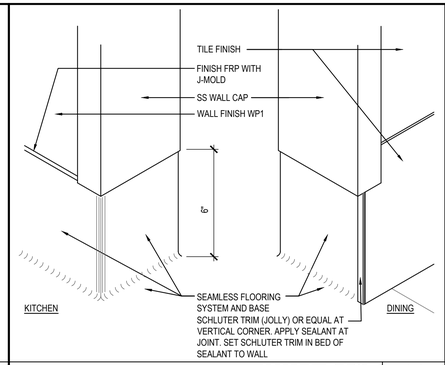

Scale= 3" = 1'-0" | A-404

TYPICAL WALL BASE | 12

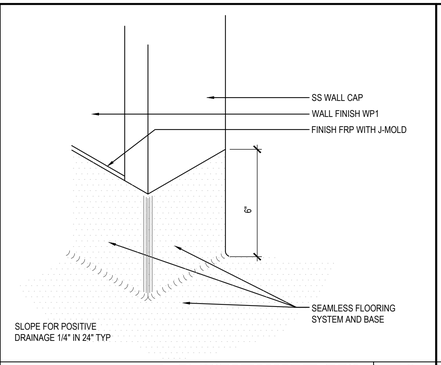

Scale= 3" = 1'-0" | A-404

S.S. DETAIL @ COOLER / FREEZER | 8

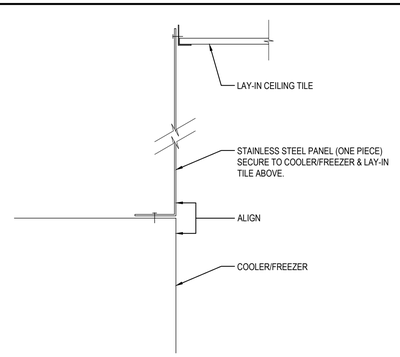

Scale= 1/2" = 1'-0" | A-404

6" CURB DETAIL | 4

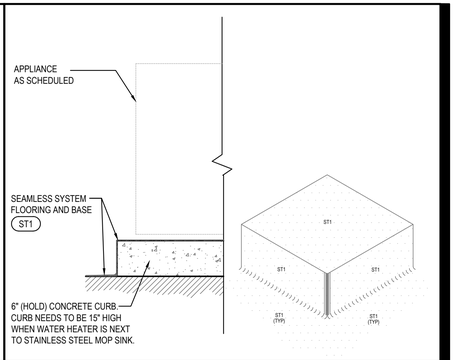

Scale= 1" = 1'-0" | A-404

MANAGER CABINET STATION CURB SIZES REFER FLR. PLAN FOR LOCATION

1) IF CABINET IS ENCLOSED BY 3 SIDE OF WALLS:
8" H X 24" W X 48-1/2" L (CONCRETE CURB ONLY, NOT INCLUDE SEAMLESS BASE)
SEAMLESS SYSTEM ON FRONT FACE (EXPOSED CURB). THIS APPLY TO PROTOTYPE BUILDING LAYOUTS.

2) IF CABINET ENCLOSED BY ONLY (1) ONE WALL:
8" H X 24" W X 46" L (CONCRETE CURB ONLY, NOT INCLUDE SEAMLESS BASE)
SEAMLESS SYSTEM ON FRONT AND (1) SIDE FACE (EXPOSED CURB)

3) IF CABINET OPEN WITH NO WALLS:
8" H X 24" W X 46" L (CONCRETE CURB ONLY, NOT INCLUDE SEAMLESS BASE)
SEAMLESS SYSTEM ON ALL 3 SIDES OF THE CURB

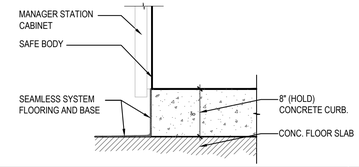

MGR. STATION & SAFE CURB | 20

Scale= 1" = 1'-0" | A-404

OUTSIDE CORNER ISOMETRIC | 13

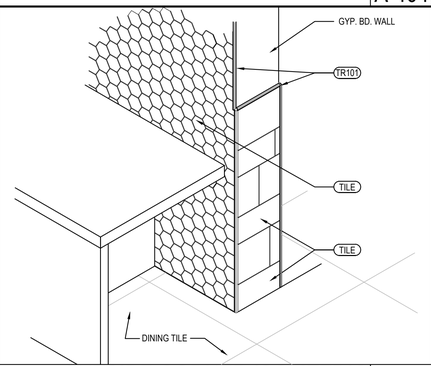

Scale= 3/4" = 1'-0" | A-404

PLAN SECTION WALL DETAIL | 11

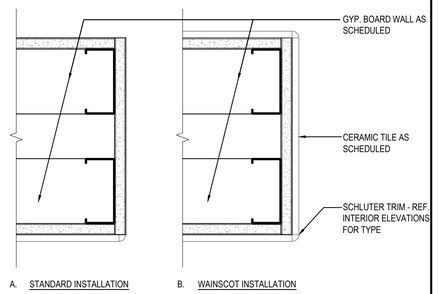

Scale= 3" = 1'-0" | A-404

WALL BASE @ COOLER | 7

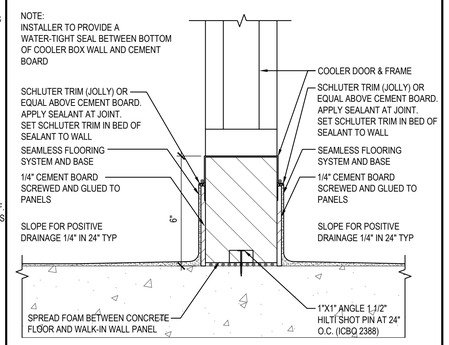

Scale= 3" = 1'-0" | A-404

WALL BASE @ COOLER | 3

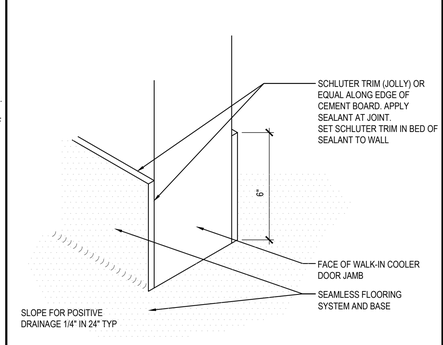

Scale= 3" = 1'-0" | A-404

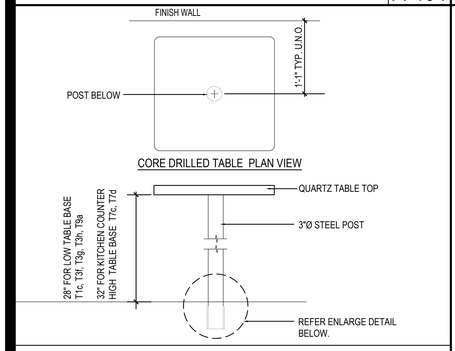

NOTE:
G.C. TO REFER CORE DRILL LOCATION ON SHEET A-109

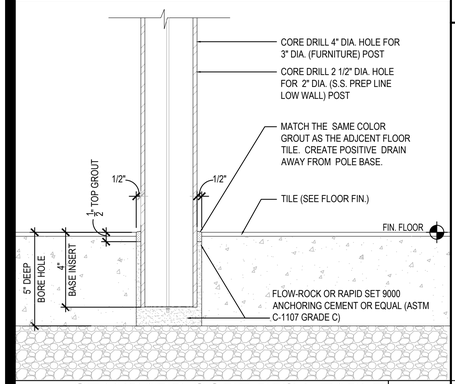

STANDARD CORE DRILL TABLE | 17

NTS | A-404

4 X BLOCKING WITH U-HANGERS AT EACH END WHERE BRACE IS BETWEEN TRUSS

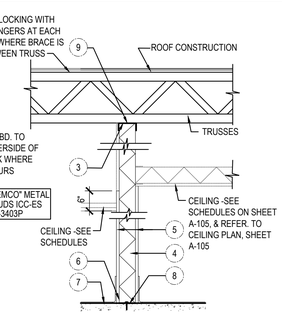

PARTITION PERPENDICULAR TO TRUSSES

HEIGHT	METAL STUD SIZE & SPACING
UP TO 12'-0"	1⅝"x3⅝"x20Ga @ 16" O.C.
BRACING LENGTH	SIZE
6'-0" OR UNDER	3⅝"x20Ga
6'-1" TO 8'-0"	4"x20Ga

1. STRUCTURAL MEMBER ABOVE
2. BRACING @ 4'-0" O.C. STAGGERED W/ 3#10 EA. END
3. 20 Ga. CONT. TRACK W/ 8# SCREW/STUD
4. METAL STUDS (SEE SCHEDULE)
5. SEE ARCHITECTURAL FOR FINISH
6. CONT. 20 Ga. UNPUNCHED TRACK (1 1/16" FLANGE)
7. CONCRETE SLAB
8. HILTI POWDER ACTUATED FASTENER .145 Ø x 1 1/2" PENETRATION @ 32" O.C. OR EQUAL
9. 18 Ga. UNPUNCHED 3" DEEP LEG TRACK W/ 3 #10 SCREWS
10. #8 SCREW PER STUD TYPICAL CONNECTION EA. FLANGE OF STUD TO STEEL TRACK (TOP & BOTT. TRACK)

2 X BLOCKING @ 48" O.C. WITH U-HANGERS EACH END

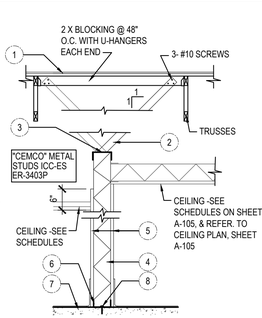

PARTITION PARALLEL TO TRUSSES

PARTITION DETAILS | 10

Scale= 3/4" = 1'-0" | A-404

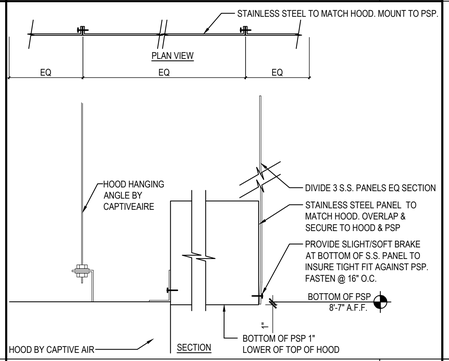

S.S. DETAIL @ EXHAUST HOOD | 6

Scale= 1/2" = 1'-0" | A-404

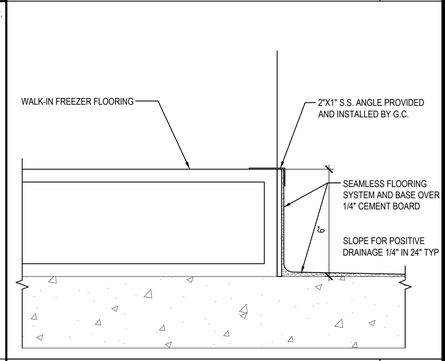

WALL BASE @ FREEZER | 2

Scale= 3" = 1'-0" | A-404

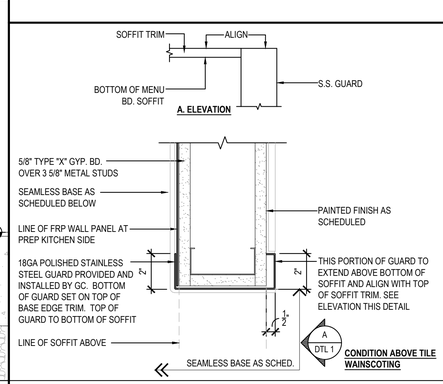

CORNER GUARD DETAIL | 9

Scale= 3" = 1'-0" | A-404

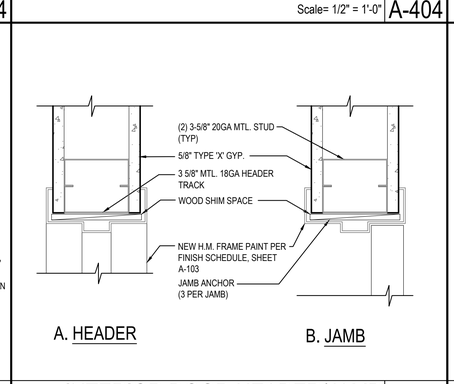

INTERIOR DOOR HEADER/JAMB | 5

Scale= 3" = 1'-0" | A-404

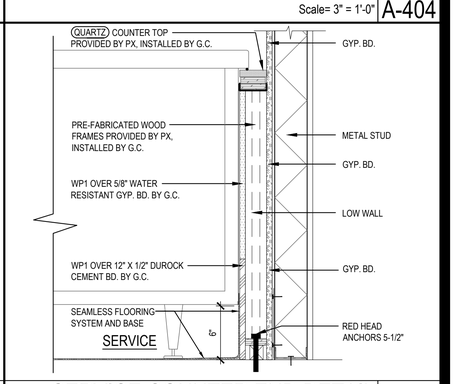

SERVICE COUNTER END DETAIL | 1

Scale= 1 1/2" = 1'-0" | A-404

PANDA EXPRESS CHINESE KITCHEN

PANDA RESTAURANT GROUP INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

1	CHECK SET	10-23-20
2	PERMIT SET	03-15-21
3	BID SET	04-02-21

DRAWN BY: JO

PANDA PROJECT #: S4-21-D7864
ARCH PROJECT #: P7350

cph
www.cphcorp.com
A Full Service A & E Firm

Plans Prepared By
CPH Design, Inc.
500 West Fulton St.
Sanford, FL 32771
Ph: 407.322.6841
State of Virginia Licenses:
Engineer No. 407006317
Surveyor No. N/A
Architect No. 407006317
Landscape No. 407006317

PANDA EXPRESS
END CAP - TENANT BUILD OUT
4501 S LABURNUM AVE
RICHMOND VA, 23231

A-404

ARCHITECTURAL DETAILS